

Registration No. 1280

JAXA-QTS-2110/A114F

1 October 2023

Superseding

JAXA-QTS-2110/A114E

Cancelled

1 October 2023

TRANSFORMERS AND INDUCTORS, POWER,  
HIGH RELIABILITY, SPACE USE,  
(NASDA 2110/A114 TYPE)  
DETAIL SPECIFICATION FOR

Prepared and Established by TAMURA Corporation

Issued by Japan Aerospace Exploration Agency

This document is the English version of JAXA QTS/ADS which was originally written and authorized in Japanese and carefully translated into English for international users. If any question arises as to the context or detailed description, it is strongly recommended to verify against the latest official Japanese version.

The release date of the English version of this specification: 1 July 2025

JAXA-QTS-2110/A114F 1 October 2023		J A X A Parts Specification	Page	– i –
Record of revisions				
Rev.	Date	Description		
NC	30 Sep. 2005	Original		
A	7 Feb. 2008	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. A)		
B	30 May 2012	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. B)		
C	3 July 2017	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. C)		
D	1 Apr. 2019	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. D)		
E	13 Dec. 2019	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. E)		
F	1 Oct. 2023	Reflected the change of document by TAMURA Corporation Document No: E-A4-30328 (Rev. F)		
		The remainder of this page is intentionally left blank.		

JAXA-QTS-2110/A114F 1 October 2023		J A X A Parts Specification	Page	– ii –
E-A4-30328F				
Revision history				
Rev.	Date	Description		
NC	30 Sep. 2005	Original		
A	7 Feb. 2008	<p>(1) Extended the qualification coverage regarding terminal strength. (Tables 2 and 3)</p> <ul style="list-style-type: none"> <li>• PTFE lead wire larger than AWG 18: from 13.7N maximum to 19.6N maximum</li> <li>• Direct wiring wire over <math>\phi 1.14\text{mm}</math>: from 9.8N maximum to 19.6N maximum</li> </ul> <p>(2) Corrected marking items and abbreviation rule of markings in accordance with the actual markings. (paragraph 3.2)</p> <p>(3) Changed wiring ratio as follows to be consistent with the qualification coverage. (Table 4)</p> <ul style="list-style-type: none"> <li>• (3-4)/(1-2): from <math>2.533 \pm 3\%</math> to <math>2.467 \pm 3\%</math></li> <li>• (7-8)/(1-2): from <math>2.533 \pm 3\%</math> to <math>2.467 \pm 3\%</math></li> </ul>		
B	30 May 2012	<p>(1) Changed the temperature at 3rd step of thermal shock in Table 3. From 115°C to 130°C (The temperature of 130°C means the maximum operating temperature in this detail specification.)</p>		
C	3 July 2017	<p>Paragraph 1.1: Scope Added the wording "The products per this specification are manufactured ...or Wakayanagi Tamura Corporation (Kurihara city of Miyagi)" in the text.</p> <p>Paragraph 3.2: Externals, Construction, Dimensions, Marking and Mass Added the wording "Additionally, manufacture line identification letter "W" is added to..." in the text. Added a marking example in item (4).</p>		
D	1 Apr. 2019	<p>Paragraph 1.1: Scope Deleted the description about TAMURA Corporation (Sakado city of Saitama) due to unification of the facility.</p> <p>Paragraph 3.2: Externals, Construction, Dimensions, Marking and Mass Changed the description about TAMURA Corporation due to unification of the facility. Changed the wording from "manufacturer line identification letter" to "manufacturer line letter" and deleted the wording "No letter added: Tamura Corporation" in a marking example in item (4).</p>		
F	1 Oct. 2023	<p>Paragraph 2: Applicable Documents Changed the wording from "Applicable documents shall be as specified in paragraph A.2.1, appendix A of JAXA-QTS-2110." to "Applicable documents shall be in accordance with paragraph A.2.1, appendix A of JAXA-QTS-2110 and as follows." in the text. Added MIL-W-16878E as an applicable document in item a). Added the note "* As soon as the insulated electrical wires of the MIL-W-16878D are no longer available, those wires of the MIL-W-16878E shall be applied." in item a).</p>		



JAXA-QTS-2110/A114F 1 October 2023	J A X A Parts Specification	Page	– iv –
			E-A4-30328F
<b>Contents</b>			
1. GENERAL .....			1
1.1 Scope.....			1
1.2 Part Number .....			1
1.3 Rating .....			1
2. APPLICABLE DOCUMENTS.....			2
3. REQUIREMENTS .....			2
3.1 Qualification Coverage .....			2
3.2 Externals, Construction, Dimensions, Marking and Mass .....			3
3.3 Performance .....			4
3.4 Electrical Characteristics .....			6
4. QUALITY ASSURANCE PROVISIONS.....			7
4.1 In-Process Inspection.....			7
4.2 Qualification Test .....			7
4.3 Quality Conformance Inspection .....			7
4.4 Long-Term Storage .....			7
4.5 Change to Tests and Inspections .....			7
5. PREPARATION FOR DELIVERY .....			7
6. NOTE .....			7

**TRANSFORMERS AND INDUCTORS, POWER,  
HIGH RELIABILITY, SPACE USE,  
(NASDA 2110/A114 TYPE)  
DETAIL SPECIFICATION FOR**

**1. GENERAL**

**1.1 Scope**

This specification establishes the detail requirements for toroidal transformers and inductors with an MPP core (NASDA 2110/A114 type) specified in JAXA-QTS-2110. The products under this specification are manufactured in Wakayanagi Tamura Corporation (Kurihara city of Miyagi).

The transformers and inductors specified in this specification do not meet outgassing requirements.

**1.2 Part Number**

The part number shall be indicated in accordance with paragraph A.1.2, appendix A of JAXA-QTS-2110 as shown below. When a purchaser designates a specific part number, corresponding part number in this specification shall be stipulated in a product specification.

(Example)

NASDA <sup>(1)</sup> 2110/A114 – T000

Identification number

Note: <sup>(1)</sup> "NASDA" indicates the part is for space use and may be abbreviated "N".

**1.3 Rating**

The rating shall be as specified in Table 1.

**Table 1. Rating**

Item	Applicable paragraph of JAXA-QTS-2110	Identification number	
		T000	T001 or subsequent
Grade	A.3.3.8	6 (open type)	
Operating ambient temperature	–	-55 to +100°C	As specified in the product specification.
Class	A.3.6.1	S (130°C)	
Operating frequency	–	20kHz	
Input voltage	–	50Vrms	
Output power	–	253VA	

JAXA-QTS-2110/A114F 1 October 2023	J A X A Parts Specification	Page	– 2 –
E-A4-30328F			
2. APPLICABLE DOCUMENTS			
Applicable documents shall be as specified in paragraph A.2.1, appendix A of JAXA-QTS-2110 and as follows.			
a) MIL-W-16878E: Wire, Electrical, Insulated, General Specification for			
* As soon as the insulated electrical wires of the MIL-W-16878D are no longer available, those wires of the MIL-W-16878E shall be applied.			
3. REQUIREMENTS			
Requirements shall be as specified in paragraph A.3, appendix A of JAXA-QTS-2110 and as follows.			
3.1 Qualification Coverage			
The qualification coverage shall be as specified in Table 2.			
Table 2. Qualification Coverage			
No.	Item	Specification to be covered	
1	Class (maximum operating temperature)	S (130°C) maximum	
2	External/internal mounting structure	Adhesion or combination of adhesion and screwing	
	External dimensions (mm)	φ80 x 48 <sup>H</sup> maximum	
	Total volume (cm <sup>3</sup> )	241.2 maximum	
3	Operating voltage	175V <sub>peak</sub> maximum	
	Insulator	Polyester, equivalent or better	
4	Magnet wire diameter (mm)	φ0.14 minimum	
	Coating material	Polyester, equivalent or better	
5	Grade	6	
	Insulation, impregnation, and filling material	Epoxy impregnation	
6	Construction and material of terminal	PTFE lead wire (AWG 28 minimum) Direct wiring wire (φ0.4mm minimum)	
	Terminal strength	MIL-STD-202, test method 211, test condition A PTFE lead wire: 19.6N maximum (larger than AWG 18) : 13.7N maximum (AWG 28 to 18) Direct wiring wire: 19.6N maximum (larger than φ1.14mm) : 9.8N maximum (φ0.4mm to 1.14mm)	
7	Shock	MIL-STD-202, test method 213 Test conditions: 1,000G, 0.4ms, semi sine wave maximum	
	Vibration	MIL-STD-202, test method 204, test condition D maximum MIL-STD-202, test method 214, test condition II-H maximum	
8	Core material	MPP	
	Core shape	Toroidal type	
9	Dielectric withstanding voltage	AC 500V maximum	



### 3.2 Externals, Construction, Dimensions, Marking and Mass

The externals, constructions, dimensions and mass shall be as specified in Figure 1. Marking items shall be as follows in accordance with paragraph A.3.4.1, appendix A of JAXA-QTS-2110. If the product specification has marking requirements, marking shall be made as specified in the product specification. Marking location shall be as shown in Figure 1. Additionally, manufacture line letter “W” is added to the end of the serial number or to the location specified in the product specification.

- (1) Part number in this specification
- (2) Terminal identification (see Figure 1)
- (3) Lot identification code
- (4) Serial number and manufacture line letter

(Marking example)


Serial number        No. 1 W        Manufacture line letter:  
Letter “W”: Wakayanagi Tamura Corporation

#### (5) Trademark

If the marking area on the transformer or inductor is limited, the items above may be abbreviated or omitted in the following order of precedence.

- (1) “2110/A” of the part number
- (2) Trademark

E-A4-30328F

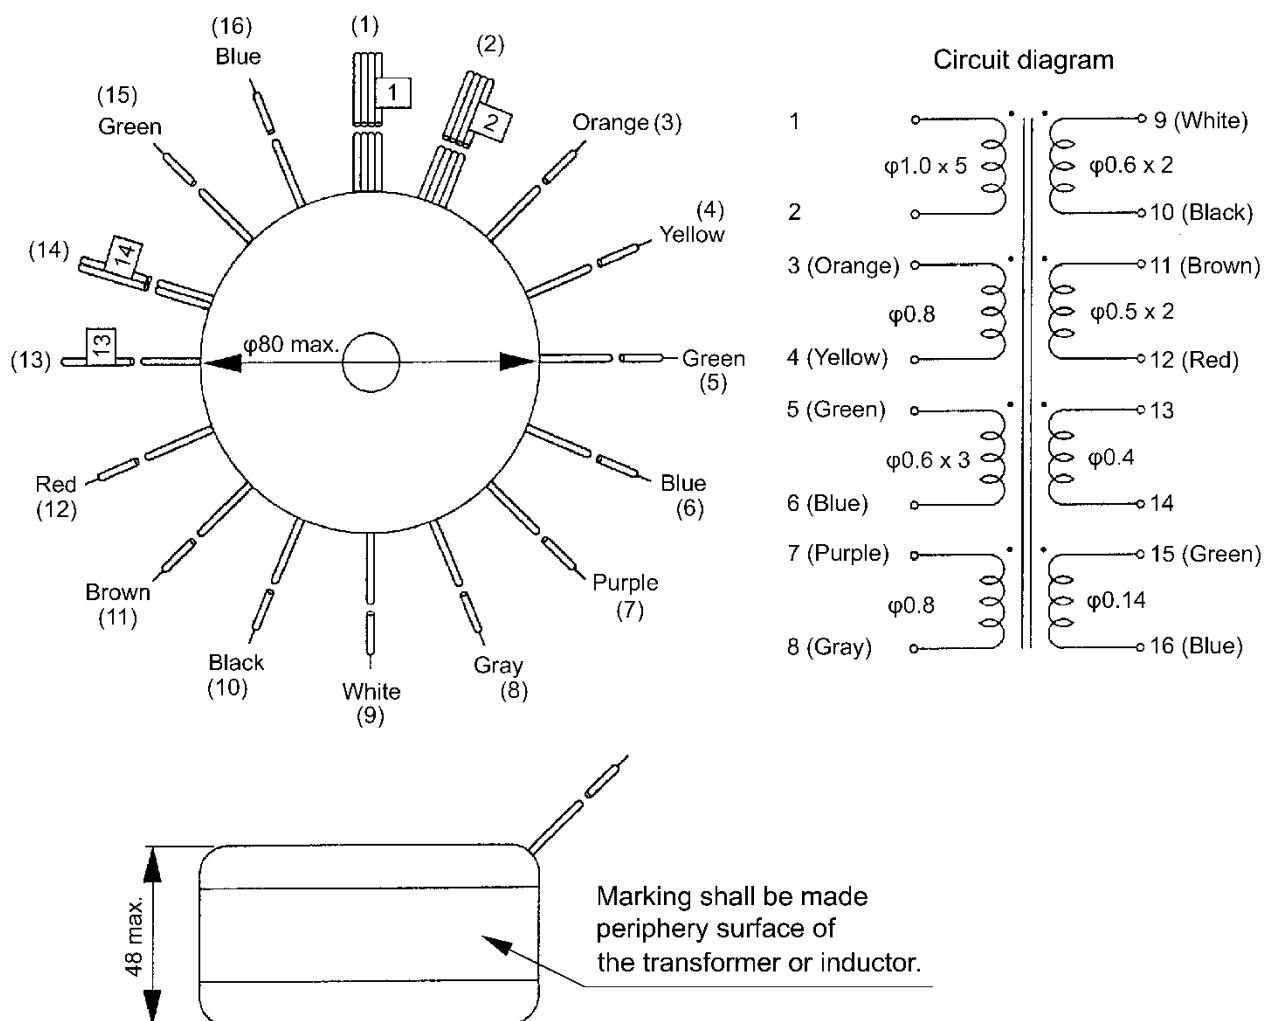

Unit: mm

- Lead wire length: 100mm minimum  
AWG 18 for terminals 5, 6  
AWG 20 for terminals 3, 4, 7, 8, 9, 10, 11, 12  
AWG 28 for terminals 15, 16  
Direct wiring wires of  $\phi 1.0\text{mm} \times 5$  for terminals 1, 2  
Direct wiring wires of  $\phi 0.4\text{mm}$  for terminals 13, 14  
Coating removed approx. 10mm at the end
- Mass: 900g maximum

**Figure 1. External, Construction, Dimensions, Marking and Mass (¹)**

Note: (¹) Figure 1 shall be applicable to all certified products. Externals, construction, dimensions, marking and mass of Individual product included in the qualification coverage shall be as specified in the product specification.

### 3.3 Performance

Performance requirements shall be as specified in Table 3.

JAXA-QTS-2110/A114F 1 October 2023	J A X A Parts Specification	Page	– 5 –
E-A4-30328F			
Table 3. Performance Requirements <sup>(1)</sup>			
Item	Requirement paragraph of JAXA-QTS-2110	Performance	
Electrical characteristics	A.3.7.1	As specified in Table 4.	
Dielectric withstanding voltage	A.3.7.2	At sea level: AC500V for 1 minute At reduced pressure: 1.1kPa, AC300V for 1 minute	
Interlayer withstanding voltage	A.3.7.3	100kHz, sine wave of 100Vrms applied between (1-2) for 5±0.5s	
Insulation resistance	A.3.7.4	DC100V, a) 10,000MΩ minimum	
Corona discharge	A.3.7.5	N/A	
Temperature rise	A.3.7.6	30°C maximum (ambient temperature: 100°C)	
Overload	A.3.7.7	Ambient temperature: 130°C – measured temperature rise	
Electrical Continuity	A.3.7.8	As specified in appendix A of JAXA-QTS-2110.	
Terminal strength (pull)	A.3.8.1	PTFE lead wire: 19.6N (larger than AWG 18) : 13.7N (AWG 28 to 18) Direct wiring wire: 19.6N (larger than ϕ1.14mm) : 9.8N (ϕ0.4mm to 1.14mm)	
Solderability	A.3.8.2	N/A	
Resistance to soldering heat	A.3.8.3	N/A	
Seal	A.3.8.4	N/A	
Vibration	A.3.9.1	High frequency: As specified in appendix A of JAXA-QTS-2110. Random: As specified in appendix A of JAXA-QTS-2110.	
Shock	A.3.9.2	Test conditions: 1,000G, 0.4ms, semi sine wave	
Thermal shock	A.3.9.3	Test condition A-1 (temperature at 3rd step: 130°C)	
Immersion	A.3.9.4	N/A	
Moisture resistance	A.3.9.5	As specified in appendix A of JAXA-QTS-2110.	
Flammability	A.3.9.6	N/A	
Resistance to solvents	A.3.9.7	N/A	
Life	A.3.10.1	Ambient temperature: 130°C – measured temperature rise	
Note: <sup>(1)</sup> This table shall be applicable to all certified products. Performance of individual product included in the qualification coverage shall be specified in the product specification.			

E-A4-30328F

## 3.4 Electrical Characteristics

The electrical characteristics shall be as shown in Table 4.

**Table 4. Electrical Characteristics <sup>(1)</sup>**

Item	Rating
Operating frequency	20kHz±10% (sine wave)
Power supply voltage	50Vrms
Winding ratio	$(3-4) / (1-2) = 2.467 \pm 3\%$ $(5-6) / (1-2) = 1.000 \pm 3\%$ $(7-8) / (1-2) = 2.467 \pm 3\%$ $(9-10) / (1-2) = 1.200 \pm 3\%$ $(11-12) / (1-2) = 1.200 \pm 3\%$ $(13-14) / (1-2) = 1.000 \pm 3\%$ $(15-16) / (1-2) = 0.800 \pm 4\%$
Inductance	(1-2) = 90μH minimum at 10kHz, 0.1V, DC 10A
DC resistance (at 20°C)	(1-2) = 0.03Ω maximum, (9-10) = 0.30Ω maximum (3-4) = 0.40Ω maximum, (11-12) = 0.35Ω maximum (5-6) = 0.20Ω maximum, (13-14) = 0.90Ω maximum (7-8) = 0.45Ω maximum, (15-16) = 5.00Ω maximum
Output	253VA
Polarity	Test points 1, 3, 5, 7, 9, 11, 13, and 15 shall have the same polarity.
Test circuit	

Note: <sup>(1)</sup> This table shall be applicable to all certified products. Electrical characteristics of individual product included in the qualification coverage shall be as specified in the product specification.

JAXA-QTS-2110/A114F 1 October 2023	J A X A Parts Specification	Page	– 7 –
<div style="text-align: right;">E-A4-30328F</div> <div> <p>4. QUALITY ASSURANCE PROVISIONS</p> <p>Quality assurance provisions shall be as specified in paragraph A.4, appendix A of JAXA-QTS-2110.</p> <p>4.1 In-Process Inspection</p> <p>The in-process inspection shall be as specified in paragraph A.4.1, appendix A of JAXA-QTS-2110.</p> <p>4.2 Qualification Test</p> <p>The qualification test shall be as specified in paragraph A.4.2, appendix A of JAXA-QTS-2110.</p> <p>4.3 Quality Conformance Inspection</p> <p>The quality conformance inspection shall be as specified in paragraph A.4.3, appendix A of JAXA-QTS-2110.</p> <p>4.4 Long-Term Storage</p> <p>Long-term storage shall be as specified in paragraph A.4.5, appendix A of JAXA-QTS-2110.</p> <p>4.5 Change to Tests and Inspections</p> <p>a) Insulation Resistance</p> <p style="padding-left: 40px;">(Standard) Insulation resistance in accordance with test method 302 of MIL-STD-202 is specified as follows.</p> <p style="padding-left: 80px;">“If the instrument reading indicates that an insulation resistance meets the specified limit (2 minimum), and is steady or increasing, the test may be terminated before the end of the specified period (2 minimum) “</p> <p style="padding-left: 40px;">(Shortening of test time)</p> <p style="padding-left: 80px;">From the test result and verification result, it was verified that the instrument reading increases or become stable within 2 minutes from the start of voltage application. Therefore, when the above condition is met and the measurement reaches the 10-times of 10 thousand MΩ as a minimum (which is more than 100 thousand MΩ), the test may be terminated before 2-minute passes.</p> <p>5. PREPARATION FOR DELIVERY</p> <p>Preparation for delivery shall be as specified in paragraph A.5, appendix A of JAXA-QTS-2110.</p> <p>6. NOTE</p> <p>Details of notes shall be as specified in paragraph A.6, appendix A of JAXA-QTS-2110.</p> </div>			