

Cancelled

Title: TRANSFORMERS AND INDUCTORS, POWER,
(OUTGASSING-QUALIFIED),
HIGH RELIABILITY,SPACE USE,
DETAIL SPECIFICATION FOR
(JAXA 2110/A152 TYPE)

Document number: JAXA-QTS-2110/A152F

Cancellation date: 1 October 2023

JAXA
JAPAN AEROSPACE EXPLORATION AGENCY

Registration No. 1267

JAXA-QTS-2110/A152F

28 March 2023

Superseding

JAXA-QTS-2110/A152E

Cancelled

28 March 2023

TRANSFORMERS AND INDUCTORS, POWER,
(OUTGASSING-QUALIFIED),
HIGH RELIABILITY, SPACE USE,
(JAXA 2110/A152 TYPE)
DETAIL SPECIFICATION FOR

Prepared and Established by TAMURA CORPORATION

Issued by JAPAN AEROSPACE EXPLORATION AGENCY

This document is the English version of JAXA QTS/ADS which was originally written and authorized in Japanese and carefully translated into English for international users. If any question arises as to the context or detailed description, it is strongly recommended to verify against the latest official Japanese version.

The release date of the English version of this specification: 27 March 2024

Revision history

Rev.	Date	Description
NC	31 May 2006	Original
A	7 Feb. 2008	(1) Extended the qualification coverage regarding construction and material of terminal. (Table 2) <ul style="list-style-type: none"> • PTFE lead wire (30 to 18 AWG) → (30 AWG min.) • Direct wiring wire (ϕ0.4mm to 1.14mm) → (ϕ0.4mm min.) (2) Extended the qualification coverage regarding terminal strength. (Tables 2 and 3) <ul style="list-style-type: none"> • PTFE lead wire over 18 AWG: 13.7N max. → 19.6N max. • Direct wiring wire over ϕ1.14mm: 9.8N max. → 19.6N max.
B	30 May 2012	(1) Changed the temperature at 3rd step of Thermal shock from 115°C to 130°C in Table 3. (130°C to be the highest operating temperature)
C	5 Feb. 2016	Paragraph 1.1: Scope: Added “The products per this specification are manufactured or Wakayanagi Tamura Corporation (Kurihara city of Miyagi)” Paragraph 3.2: Externals, Construction, Dimensions, Marking and Mass: Added “Additionally, manufacture line identification code “W” is added to.” and a marking example in (4).
D	1 Apr. 2019	Paragraph 1.1: Scope: Deleted the description about Tamura Corporation (Sakado city of Saitama) due to unification of the facility. Paragraph 3.2: Externals, Construction, Dimensions, Marking and Mass: <ul style="list-style-type: none"> ▪ Changed description due to unification of the facility. ▪ Changed manufacturer line identification letter to manufacturer line letter in the text and marking example.
E	13 Dec. 2019	Paragraph 3.2: Externals, Construction, Dimensions, Marking and Mass: (4) Added “and manufacture line letter.” (error corrected) Paragraph 4.5: Change to tests and inspections: Added the description about the shortening of applied time of the test voltage in insulation resistance test.
F	28 March 2023	Extended the qualification coverage for the following items to the same scope of qualification as A116 type. <ul style="list-style-type: none"> •Operating voltage: 175Vpeak max. → 250Vpeak max. •Dielectric withstanding voltage AC500V max.→ AC700V max. •Shock 840G 0.6ms max. → 1000G 0.4ms max. Table 1 •Output power 97VA→100VA Table 2 •Operating voltage 175Vpeak max.→250Vpeak max. In case of coil, 175Vpeak max. <ul style="list-style-type: none"> •Added Electric field strength •Dielectric withstanding voltage: AC 500 max.→AC 700V max. •Shock (Test condition): 840G, 0.6ms → 1000G, 0.4ms

(continued)

- | | | |
|--|--|---|
| | | <p>Table 3</p> <ul style="list-style-type: none">▪Dielectric withstanding voltage, At barometric pressure:
AC500V →AC700VAt reduced pressure: AC300V →AC320V▪Insulation resistance: DC100V→DC500V▪Shock (Test Condition): 840G 0.6ms →1000G 0.4ms <p>Table 4</p> <ul style="list-style-type: none">▪Winding ratio: (3-4) / (1-2) = 1.500 ± 3% → 2.250 ± 3%(5- 6) / (1-2) = 0.800 ± 3% → 1.000 ± 3%(7- 8) / (1-2) = 1.300 ± 3% → 1.750 ± 3%(9-10) / (1-2) = 2.475 ± 3% → 3.540 ± 3%(11-12) / (1-2) = 1.300 ± 3% → 2.000 ± 3%(13-14) / (1-2) = 0.300 ± 4% → 0.500 ± 4%▪Inductance: 3.0mH →1.4mH▪DC resistance: (1-2) = 0.05Ω max.→ 0.03Ω max.(7-8) = 0.30Ω max.→ 0.25Ω max.(11-12) = 0.55Ω max → 0.50Ω max▪Output: 97VA →100VA▪Test circuit: Resistance between 9-10 500Ω → 10kΩ11-12 300Ω → 4kΩ |
| | | |

Contents

1.	GENERAL	1
1.1	Scope.....	1
1.2	Part Number.....	1
1.3	Rating	1
2.	APPLICABLE DOCUMENTS.....	2
3.	REQUIREMENTS	2
3.1	Qualification Coverage	2
3.2	Externals, Construction, Dimensions, Marking and Mass	3
3.3	Performance	5
3.4	Electrical Characteristic.....	6
4.	QUALITY ASSURANCE PROVISIONS.....	7
4.1	In-Process Inspection.....	7
4.2	Qualification Test	7
4.3	Quality Conformance Inspection	7
4.4	Long-Term Storage	7
4.5	Change to Tests and Inspections	7
5.	PREPARATION FOR DELIVERY.....	7
6.	NOTES.....	7

**JAXA 2110/A152 TYPE,
TRANSFORMERS AND INDUCTORS, POWER,
(OUTGASSING-QUALIFIED),
HIGH RELIABILITY, SPACE USE,
DETAIL SPECIFICATION FOR**

1. GENERAL

1.1 Scope

This specification establishes the detail requirements for toroidal transformers and inductors with a ferrite core (JAXA 2110/A152 type) of space use, high reliability, transformers and inductors that satisfied JAXA-QTS-2110, Transformers and Inductors, High Reliability, Space use, General Specification for. The products per this specification are manufactured in Wakayanagi Tamura Corporation (Kurihara city of Miyagi). Transformers and inductors specified herein shall meet the requirements for outgassing.

1.2 Part Number

The part number shall be indicated in accordance with paragraph A.1.2., Appendix A of JAXA-QTS-2110 as shown below. When a purchaser designates a specific part number, the corresponding part number in this specification shall be provided in a product specification.

(Example) JAXA⁽¹⁾ 2110/A152 - T000
|
Identification number

Note: (1) "JAXA" indicates the common part for space use and may be abbreviated to "J."

1.3 Rating

The rating shall be as specified in Table 1.

Table 1. Rating

Item	Applicable paragraph of JAXA-QTS-2110	Identification number	
		T000	T001 or subsequent
Grade	A.3.3.8	6 (open type)	
Operating ambient temperature	-	-55 to +100°C	As specified in the product specification.
Class	A.3.6.1	S (130°C)	
Operating frequency	-	50kHz	
Input voltage	-	50Vrms	
Output power	-	100VA	

2. APPLICABLE DOCUMENTS

Applicable documents shall be as specified in paragraph A.2.1, Appendix A of JAXA-QTS-2110.

3. REQUIREMENTS

Requirements shall be as follows and as specified in Section A.3, Appendix A of JAXA-QTS-2110.

3.1 Qualification Coverage

The qualification coverage shall be as specified in Table 2.

Table 2. Qualification Coverage

No.	Item	Specification
1	Class (maximum operating temperature)	S (130°C) max.
2	External/internal mounting construction	Adhesion or combination of adhesion and screwing
	External dimensions (mm)	φ65 x 43 ^H max.
	Total volume (cm ³)	142.6 max.
3	Operating voltage	250V _{peak} max. 175V _{peak} if it is a coil.
	Insulation	Polyester, equivalent or better
	Electric field strength	63.5V/mil max. Not applicable if it is under 175V _{peak} max.
4	Magnet wire diameter (mm)	φ0.1 min.
	Coating material	Polyester, equivalent or better
5	Grade	6
	Insulation, impregnation, and filling material	Epoxy impregnation
6	Construction and material of terminal	PTFE lead wire (30 AWG min) Direct wiring wire (φ0.4mm min)
	Terminal strength	MIL-STD-202, test method 211, test condition A PTFE lead wire: 19.6N max. (over 18 AWG) 13.7N max. (28 to 18 AWG) 9.8N max. (30 to 28 AWG) Direct wiring wire: 19.6N max. (over φ1.14mm) 9.8N max. (φ0.4mm to 1.14mm)
7	Shock	MIL-STD-202, test method 213 Test conditions: 1000G, 0.4ms, half sine wave max.
	Vibration	MIL-STD-202, test method 204, test condition D max. MIL-STD-202, test method 214, test condition II-H max.
8	Core material	Ferrite
	Core shape	Toroidal type
9	Dielectric withstanding voltage	AC 700V max.
10	Outgassing	TML: 1.0% max., CVCM: 0.1% max.

3.2 Externals, Construction, Dimensions, Marking and Mass

The externals, construction, dimensions and mass shall be as specified in Figure 1. Marking items shall be as follows in accordance with paragraph A.3.4.1, Appendix A of JAXA-QTS-2110. If the product specification has marking requirements, the marking shall be made as specified in the product specification. Additionally, manufacture line letter “W” is added to the end of the serial number or to the location specified in the product specification.


- (1) Part number in this specification
- (2) Terminal identification (See Figure 1)
- (3) Lot identification code
- (4) Serial number and manufacture line letter

(Marking example)

Serial number NO.1 W Manufacture line letter
Letter “W”: Wakayanagi Tamura Corporation

- (5) Trademark
If the marking area on the transformer or inductor is limited, the items above may be abbreviated or omitted in the following order of precedence.

- (1) “2110/A” of the part number
- (2) Trademark

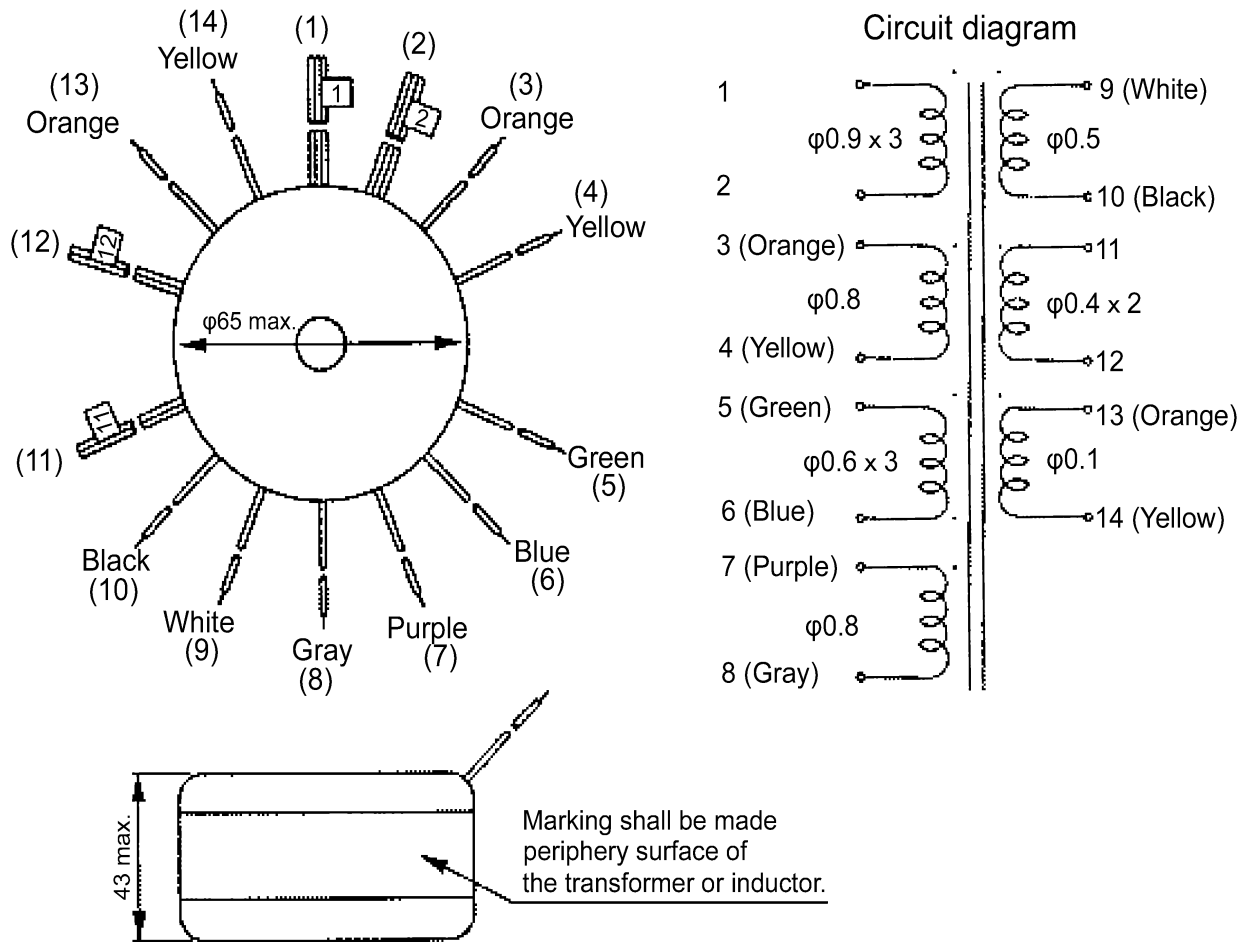

Unit: mm

1. Lead wire length: 100mm min.
No.18 AWG for terminals 5, 6
No.20 AWG for terminals 3, 4, 7, 8
No.24 AWG for terminals 9, 10
No.30 AWG for terminals 13, 14
Direct wiring wire of $\phi 0.9\text{mm} \times 3$ for terminals 1, 2
Direct wiring wire of $\phi 0.4\text{mm} \times 2$ for terminals 11, 12
Coating removed approx.10mm at the end
2. Mass: 350g max.

Figure 1. Externals, Construction, Dimensions, Marking and Mass⁽¹⁾

Note ⁽¹⁾ Figure 1 shall be applicable to all certified products. Externals, construction, dimensions, marking and mass of Individual product included in the qualification coverage shall be as specified in the product specification.

3.3 Performance

Performance requirements shall be as specified in Table 3.

Table 3. Performance Requirements (1)


Item	Requirement paragraph of JAXA-QTS-2110	Performance
Electrical characteristics	A.3.7.1	As specified in Table 4.
Dielectric withstanding voltage	A.3.7.2	At barometric pressure: AC700V for 1 minute At reduced pressure: 1.1kPa, AC320V for 1 minute
Interlayer withstanding voltage	A.3.7.3	100kHz, sine wave of 100Vrms applied between (1-2) for 5±0.5s
Insulation resistance	A.3.7.4	DC500V, a) 10,000MΩ min.
Corona discharge	A.3.7.5	N/A
Temperature rise	A.3.7.6	30°C max. (ambient temperature: 100°C)
Overload	A.3.7.7	Ambient temperature: 130°C – measured temperature rise
Electrical continuity	A.3.7.8	As specified in Appendix A of JAXA-QTS-2110.
Terminal strength (pull)	A.3.8.1	PTFE lead wire: 19.6N max. (over 18 AWG) 13.7N max. (28 to 18 AWG) 9.8N max. (30 to 28 AWG) Direct wiring wire: 19.6N max. (over φ1.14mm) 9.8N max. (φ0.4mm to 1.14mm)
Solderability	A.3.8.2	N/A
Resistance to soldering heat	A.3.8.3	N/A
Seal	A.3.8.4	N/A
Vibration	A.3.9.1	High frequency: As specified in Appendix A of JAXA-QTS-2110. Random: As specified in Appendix A of JAXA-QTS-2110.
Shock	A.3.9.2	Test conditions: 1000G, 0.4ms, half sine wave
Thermal shock	A.3.9.3	Test condition A-1 (temperature at 3rd step: 130°C)
Immersion	A.3.9.4	N/A
Moisture resistance	A.3.9.5	As specified in Appendix A of JAXA-QTS-2110.
Flammability	A.3.9.6	N/A
Resistance to solvent	A.3.9.7	N/A
Life	A.3.10.1	Ambient temperature: 130°C – measured temperature rise

Note (1) This table shall be applicable to all certified products. Performance of individual product included in the qualification coverage shall be as specified in the product specification.

3.4 Electrical Characteristic

The electrical characteristics shall be as shown in Table 4.

Table 4. Electrical Characteristics (1)

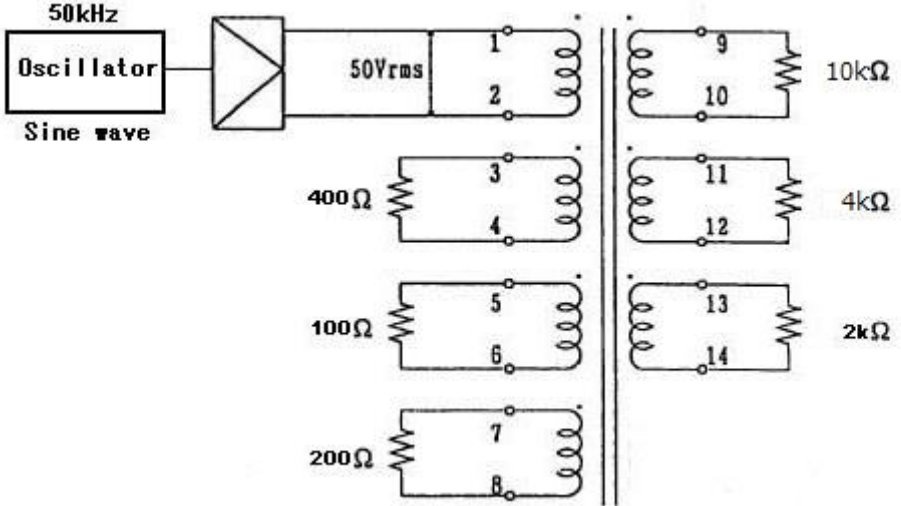Item	Rating
Operating frequency	50kHz±10%
Input voltage	50Vrms
Winding ratio	$(3-4) / (1-2) = 2.250 \pm 3\%$ $(5-6) / (1-2) = 1.000 \pm 3\%$ $(7-8) / (1-2) = 1.750 \pm 3\%$ $(9-10) / (1-2) = 3.540 \pm 3\%$ $(11-12) / (1-2) = 2.000 \pm 3\%$ $(13-14) / (1-2) = 0.500 \pm 4\%$
Inductance	(1-2) = 1.4mH min. at 10kHz, 1.0V
DC resistance (at 20°C)	(1-2) = 0.03Ω max., (9-10) = 1.20Ω max (3-4) = 0.30Ω max., (11-12) = 0.50Ω max (5-6) = 0.08Ω max., (13-14) = 4.00Ω max (7-8) = 0.25Ω max.
Output	100VA
Polarity	Test points 1, 3, 5, 7, 9, 11, and 13 shall have the same polarity.
Test circuit	 <p>The test circuit diagram shows a 50kHz sine wave oscillator connected to the primary winding (1-2) of a transformer. The secondary windings are connected to various load resistors: 10kΩ (9-10), 4kΩ (11-12), 2kΩ (13-14), 400Ω (3-4), 100Ω (5-6), and 200Ω (7-8). The transformer has a center tap on the primary winding.</p>

Note (1) This table shall be applicable to all certified products. Electrical characteristics of individual product included in the qualification coverage shall be as specified in the product specification.

4. QUALITY ASSURANCE PROVISIONS

Quality assurance provisions shall be as specified in Section A.4, Appendix A of JAXA-QTS-2110.

4.1 In-Process Inspection

The in-process inspection shall be as specified in paragraph A.4.1, Appendix A of JAXA-QTS-2110.

4.2 Qualification Test

The qualification test shall be as specified in paragraph A.4.2, Appendix A of JAXA-QTS-2110.

4.3 Quality Conformance Inspection

The quality conformance inspection shall be as specified in paragraph A.4.3, Appendix A of JAXA-QTS-2110.

4.4 Long-Term Storage

Long-term storage shall be as specified in paragraph A.4.5, Appendix A of JAXA-QTS-2110.

4.5 Change to Tests and Inspections

a) Insulation Resistance

(Standard) Insulation resistance in accordance with test method 302 of MIL-STD-202 is specified as follows. "If the instrument reading indicates that an insulation resistance meets the specified limit (2 min.), and is steady or increasing, the test may be terminated before the end of the specified period (2 min.)"

(Shortening of test time) From the test result and verification result, it was verified that the instrument reading increases or become stable within 2 minutes from the start of voltage application. Therefore, when the above condition is met and the measurement reaches the 10-times of 10 thousand MΩ as a minimum (which is more than 100 thousand MΩ), the test may be terminated before 2-minute passes.

5. PREPARATION FOR DELIVERY

Preparation for delivery shall be as specified in Section A.5, Appendix A of JAXA-QTS-2110.

6. NOTES

Details of notes shall be as specified in Section A.6, Appendix A of JAXA-QTS-2110.